National Institutes of Health
National Eye Institute

DLS Fiber Optic Probe in a Videokeratoscope

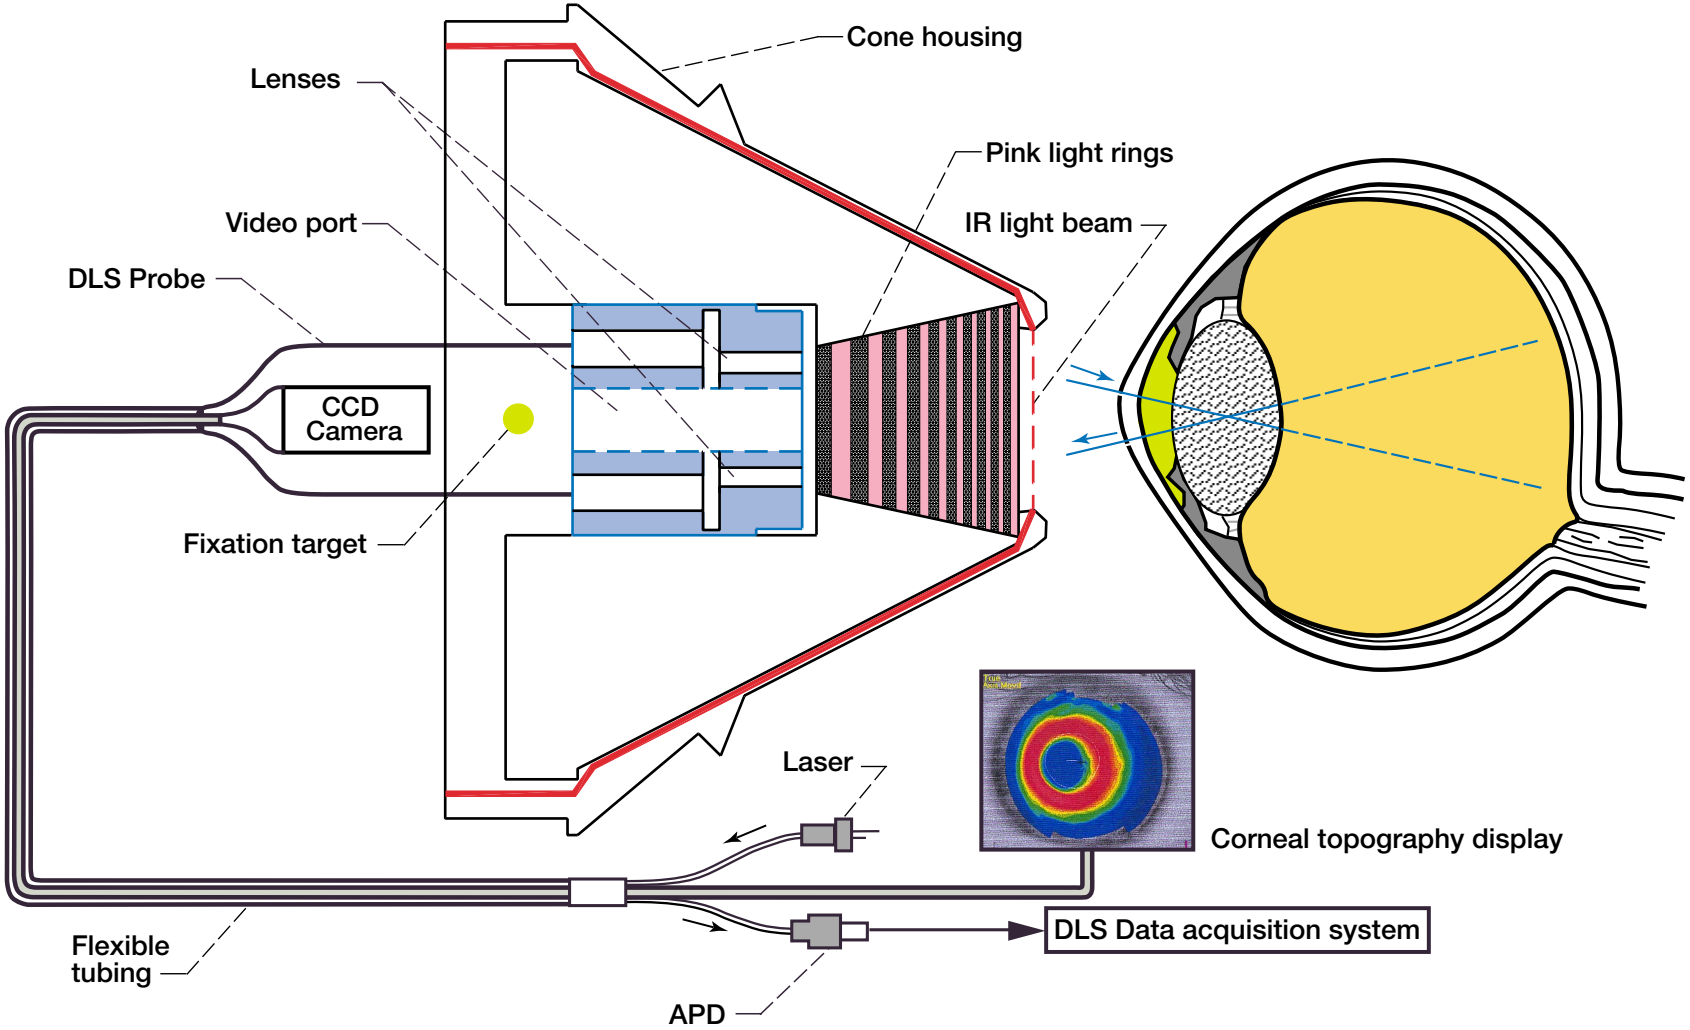

NASA Contact: Dr. Rafat R. Ansari
Phone: (216) 433–5008

79549
11-03-99

NIH Contact: Dr. Manuel B. Datiles
Phone: (301) 496–3577